

4

3

2

1








HBL560P9W

60A 3ø

120/208VAC




2002 MODEL

REVISIONS			
ZONE	REV	DESCRIPTION	DATE
			APPROVED

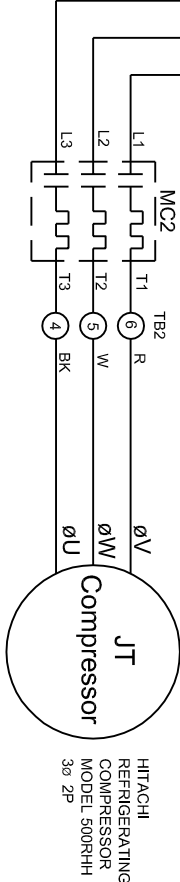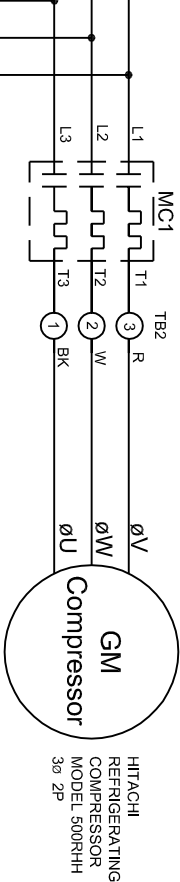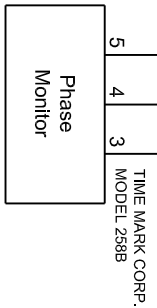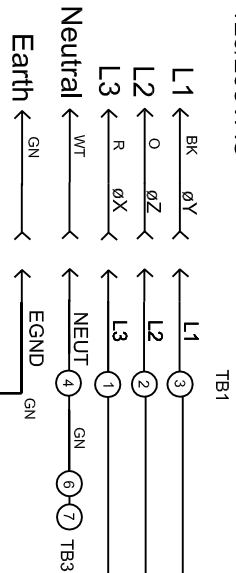


TYPE J THERMOCOUPLE BARBER-COLEMAN P111-00100-048-7-03

OMRON ESC2-R40U SETTING 20°C

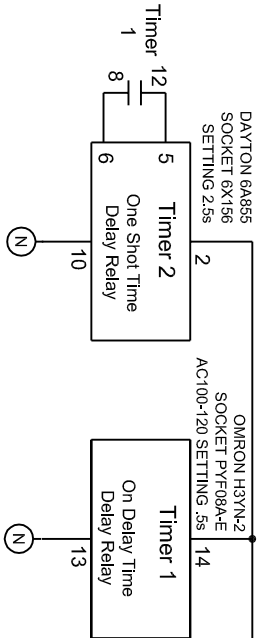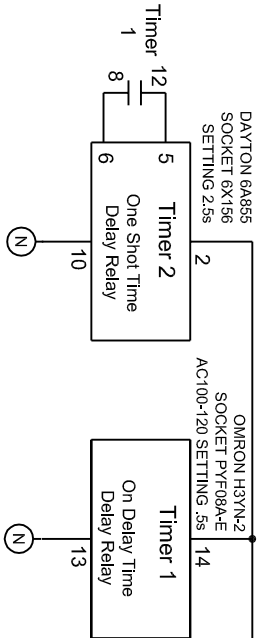

DIN RAIL 35 MM X 7.5 MM STEEL




2X464 MSB1 SPST 10A 250VAC 15A 125VAC

ZB4BA3





ZB4BV03

ZB4BZ101



DAYTON FAN MOTOR MODEL 3K615 208V 3.2A





UNITED ELECTRIC CONTROLS TYPE H402, MODEL 376 SETTINGS: 125 psi LOW, 350 psi HIGH

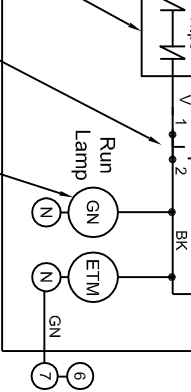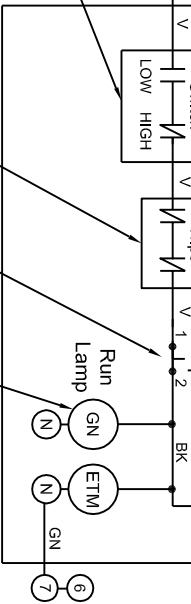

KLIXON 78T2L6B-19 OPEN @ 210F/ 30F DIFF.

ZB4BA4

ZB4BZ102

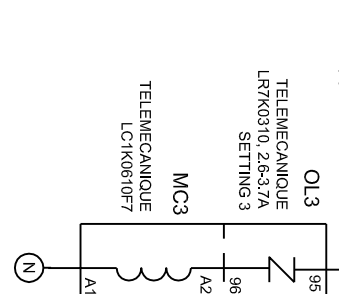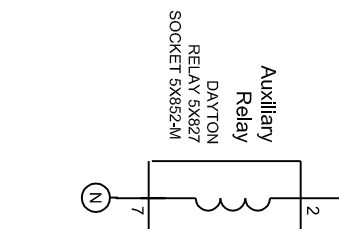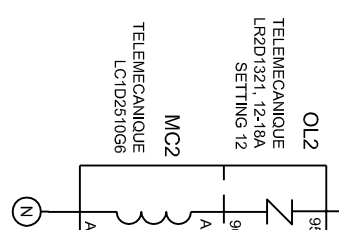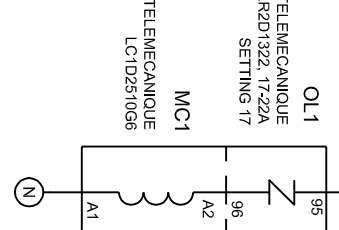

4K JT Compressor Electrics

Do Not		10/25/02	
SIZE	FSCH NO.	DWG NO.	REV
SCALE		SHEET	

4

3

2

1